


GATE VALVE SIZE	ANCHOR BLOCK DIMENSIONS	
	A (FT)	B (FT)
6	18"	14"
8	18"	16"
10	24"	18"
12	24"	20"

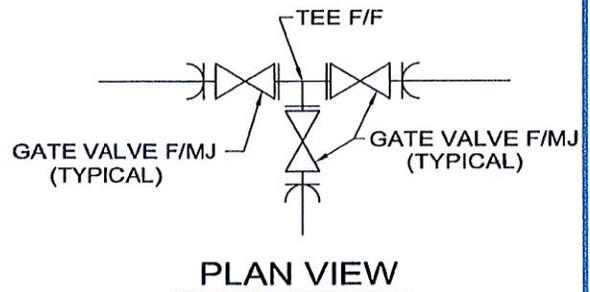

NOTES:

1. ALL GATE VALVES SHALL BE NON RISING STEM (NRS) DOUBLE O-RING SEAL. VALVES SHALL BE PER AWWA STANDARD EQUAL SIZED TO LINE PIPING. VALVES SHALL BE EPOXY COATED RESILIENT WEDGE GATE VALVES COMPLYING WITH AWWA C-509 SPECIFICATIONS. NO LEFT HANDED VALVE ALLOWED IN THE CITY.
2. CONCRETE COLLAR AND THRUST BLOCK SHALL BE CLASS 520-C-2500 PCC.
3. VALVE BOX SHALL BE CHRISTY G5 BOX WITH G5C TRAFFIC LID.
4. VALVE BOX RISER SHALL BE 8"Ø PVC SLEEVE.
5. ALL VALVES, FITTINGS AND ANCHOR BARS SHALL BE WRAPPED WITH 10 MIL. THICK POLYETHYLENE SHEET.
6. FOURTEEN (14") AND LARGER VALVES SHALL BE BUTTERFLY VALVE MANUFACTURED PER AWWA STANDARDS.

TITLE:

WATER VALVE

DRAWN BY:
LOUIE C. GUEVARA

SCALE:
NONE

APPROVED:

7/16/13

STANDARD PLAN

REVIEWED BY:
DAVID RUBCIC

REVISED:
APRIL, 2013

B-2

**CITY OF HOLLISTER
ENGINEERING DEPARTMENT**

CITY ENGINEER: RUDI GOLNIK LIC. NO. 39570 EXP. DATE: 12-31-2015

DATE

SHEET 1 OF 1