


WATER CONNECTION

SCALE: NONE

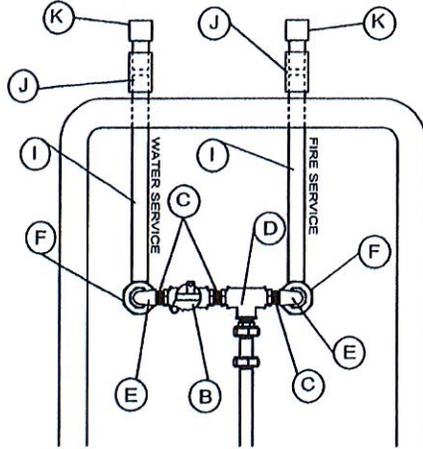

DETAIL A

SCALE: NONE

DETAIL KEY

- (A) CHRISTY W36 METERBOX WITH FIBERLYTE FL36GP LID (SEE NOTE NO. 3)
- (B) BALL VALVE WITH PADWING - 1" - B11-444W-NL
- (C) 3 - CLOSE X 1" - BRASS NIPPLE
- (D) 1 - 1" BRASS TEE
- (E) 2 - 1" ST 90° BRASS
- (F) 2 - 1" BRASS UNION
- (G) 2 - 1" X 8" BRASS NIPPLE
- (H) 2 - 1" 90° BRASS ELBOW
- (I) 2 - 1" X 12" BRASS NIPPLE
- (J) 2 - 1" BRASS COUPLER IRON PIPE THREAD
- (K) 2 - 1" PVC MIP PLUG (REMOVE WHEN CONTINUED TO STRUCTURE)
- (L) 11" SPACER
- (M) 1 - 1" METER SWIVEL X FIP (INSTALLED BY CITY / S.S.W.D.)
- (N) 1" POLYETHYLENE TUBING (CTS) (SDR9)

- NOTES:**
- METER SIZE NO LESS THAN 1" METER SUPPLIED BY CITY OF HOLLISTER / SUNNYSLOPE COUNTY WATER DISTRICT (S.S.W.D.).
 - SEPARATE PRIVATE SERVICE LINES ARE REQUIRED FOR DOMESTIC WATER AND FIRE. SERVICE LINES SHALL BE INSTALLED BY THE CUSTOMER AND SHALL BE PER UNIFORM PLUMBING CODE.
 - WATER METER BOX SHALL BE CHRISTY B36 WITH B36 FIBERLYTE LID. THE LID SHALL BE CORE DRILLED TO ACCEPT REMOTE METER READING SENSOR AND METER READING LID.
 - CUSTOMER SHALL INSTALL SUITABLE CONTROL VALVES ON EACH PRIVATE SERVICE LINE ON THE RISER TO EACH BUILDING.
 - THE MAXIMUM NUMBER OF DWELLING UNITS CONNECTED TO A COMBINATION RESIDENTIAL DOMESTIC AND FIRE SPRINKLER SERVICE SHALL NOT EXCEED ONE(1) DWELLING UNIT PER SERVICE. PROJECTS WHICH PROPOSE TO EXCEED THIS LIMITATION MUST INCLUDE A SEPARATE, DEDICATED FIRE SERVICE AND WATER SERVICE LINE FOR EACH RESIDENTIAL UNIT.
 - CONNECTIONS TO COPPER SERVICE LINES SHALL BE FLARED FITTINGS WITH POLYETHYLENE TUBING (CTS) (SDR9) INSTALL #10 INSULATED TRACER WIRE.
 - THE CITY ENGINEER / SUNNYSLOPE COUNTY WATER DISTRICT HAS THE AUTHORITY TO MODIFY THE REQUIREMENTS OF THIS STANDARD DETAIL AS NECESSARY TO ACCOMMODATE NON-TYPICAL SITUATIONS.

TITLE: COMBINATION DOMESTIC & FIRE SERVICE

AUTOCAD BY: LOUIE C. GUEVARA
 SCALE: NONE
 REVIEWED BY: DAVID RUBCIC
 REVISION: APRIL, 2013
 CITY OF HOLLISTER
 ENGINEERING DIVISION

APPROVED: *[Signature]*
 7-16-13
 CITY ENGINEER: RUDI GOLNIK LIC. NO. 39570 EXP. DATE: 12-31-2013
 DATE

STANDARD PLAN
B-3-3
 SHEET 3 OF 3