



SECTION A-A
(WITH PRECAST SECTION)

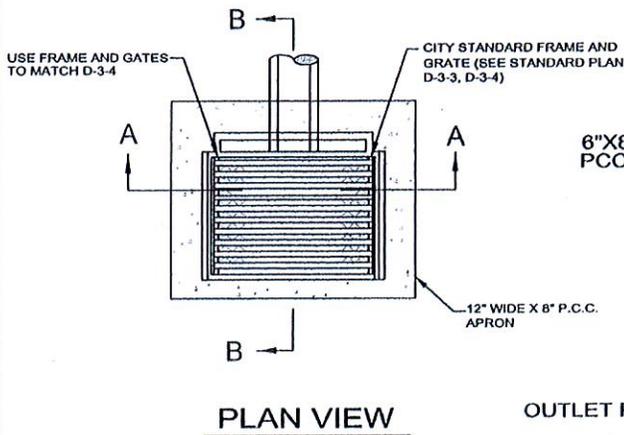

PLAN VIEW

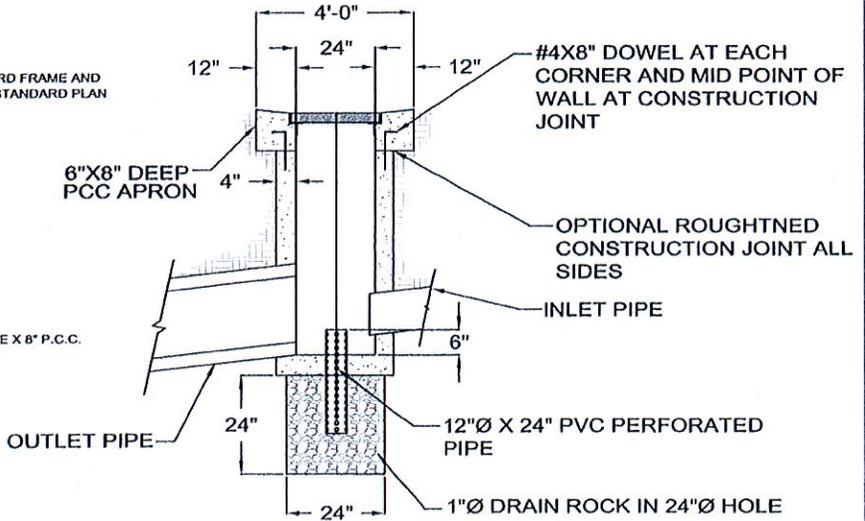

SECTION B-B
(WITH CAST -N- PLACE P.C.C.)

NOTES:

1. ALL CONCRETE SHALL BE 560-B-3250 PCC.PRECAST INLETS.
2. CAST - IN - PLACE INLET BASE SHALL BE PLACED AGAINST UNDISTURBED EARTH.
3. NO CONCRETE SHALL BE PLACED PRIOR TO APPROVAL BY THE CITY ENGINEER, OR PUBLIC WORKS INSPECTOR.
4. PIPES MAY BE PLACED IN ANY WALL TO BE GROUTED IN PLACED.
5. REINFORCING BARS SHALL BE REQUIRED IN WALLS WHICH ARE MORE THAN 6' DEEP. FROM TOP OF CURB HORIZONTAL AND VERTICAL BARS SHALL BE #4, SPACE 12" O.C. AND PLACED AT 2" CLEAR OF INSIDE WALL SURFACE.
6. PRECAST INLETS ARE SUBJECT TO WRITTEN APPROVAL OF THE CITY ENGINEER, EXCAVATION TO BE MIN. 4" LARGER THAN PRECAST BOX ON ALL SIDES. BACKFILL WITH CLASS 100-E-100 PCC.

TITLE:

DROP INLET (24" X 36")

DRAWN BY: LOUIE C. GUEVARA
 SCALE: NONE
 REVIEWED BY: DAVID RUBCIC
 REVISED: APRIL, 2013
 CITY OF HOLLISTER
 ENGINEERING DEPARTMENT

APPROVED: *[Signature]*
 7-16-13
 CITY ENGINEER: RUDI GOLNIK LIC. NO. 39570 EXP. DATE: 12-31-2013
 DATE

STANDARD PLAN
D-3-4
 SHEET 4 OF 4