

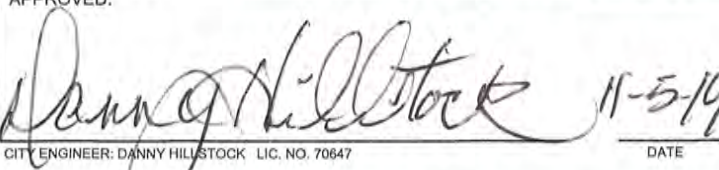
NOTES:

1. PROVIDE STRUCTURAL CALCULATION FOR USING FLAT TOP MANHOLE.
2. CAST IN PLACE MANHOLES SHALL BE 2500 PSI CONCRETE MINIMUM.
3. PRECAST MANHOLES SHALL BE 3250 PSI CONCRETE MINIMUM.
4. USE OF THIS STANDARD REQUIRES THE APPROVAL OF THE CITY ENGINEER.

TITLE:

STANDARD MANHOLE FOR PIPE COVER LESS THAN 36" COVER

DRAWN BY: STAFF	SCALE: NONE
REVIEWED BY: DANNY HILLSTOCK	REVISED: OCTOBER, 2019
CITY OF HOLLISTER ENGINEERING DEPARTMENT	

APPROVED: 
11-5-19 DATE
CITY ENGINEER: DANNY HILLSTOCK LIC. NO. 70647

STANDARD PLAN C-1-2 SHEET 2 OF 4
