


## BACKFLOW OVERFLOW DEVICE

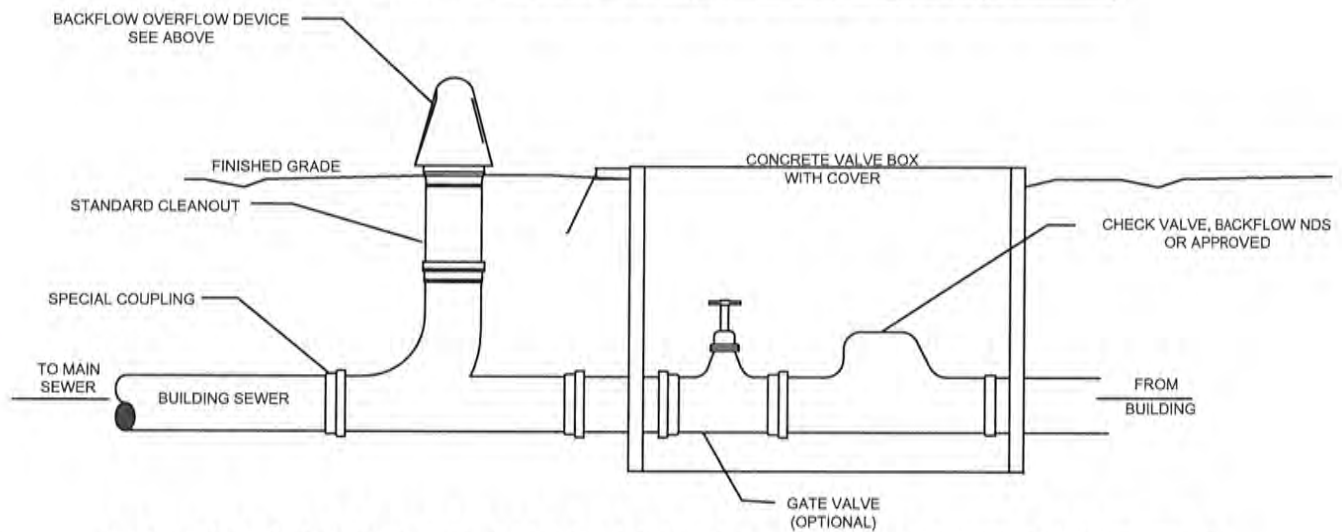

## BACKFLOW CHECK VALVE & SHUTOFF SYSTEM

**NOTES:**

1. AN OVERFLOW SYSTEM IS REQUIRED AND SHALL BE INSTALLED WHERE THE FINISH FLOOR ELEVATION OF THE BUILDING TO BE CONNECTED IS LESS THAN (1) ONE FOOT ABOVE THE RIM OF THE NEAREST UPSTREAM MANHOLE.
2. THE INSTALLATION OF THE BACKWATER OVERFLOW DEVICE SHALL BE MADE AFTER THE FINAL GRADING AROUND THE BUILDING IS COMPLETE. THE BACKWATER OVERFLOW DEVICE SHALL BE AS DETAILED, OR AN APPROVED EQUAL.
3. CONSIDERATION MUST BE GIVEN TO THE DAMAGE POTENTIAL TO ADJACENT PROPERTY OR WATER BODY BY SEWAGE RELEASED THROUGH THE BACKWATER OVERFLOW DEVICE.

TITLE:

## BACKFLOW PREVENTION DEVICES

DRAWN BY: STAFF	SCALE: NONE
REVIEWED BY: DANNY HILLSTOCK	REVISED: OCTOBER, 2019

APPROVED:

Danny Hillstock

11-5-19

CITY ENGINEER: DANNY HILLSTOCK LIC. NO. 70647

DATE

STANDARD PLAN

# C-4

SHEET 1 OF 1

CITY OF HOLLISTER  
ENGINEERING DEPARTMENT