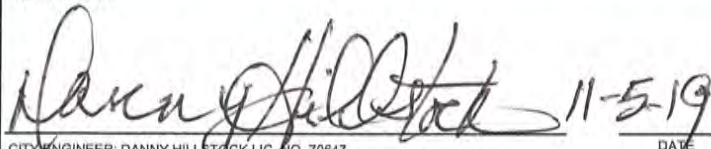


NOTES:

1. ALL THRUST BLOCKS TO BE INSTALLED ACCORDING TO THESE DETAILS UNLESS OTHERWISE NOTED OR DETAILED.
2. THE PORTLAND CEMENT CONCRETE USED FOR THRUST BLOCKS SHALL BE 450-C-2000 PCC.
3. ALL ANCHOR RODS SHALL BE GALVANIZED STEEL, MINIMUM 1/2" DIAMETER, WRAPPED AROUND PIPE.
4. FLOW DIRECTION INDICATED BY ———→
5. ALL VIEWS ARE PLAN VIEW UNLESS OTHERWISE SHOWN.
6. WRAP ALL PVC TEES AND ELBOWS WITH 10 MIL PVC TAPE PRIOR TO PLACEMENT OF CONCRETE THRUST BLOCK.
7. MIN. 1-SQUARE FOOT BEARING AREA FOR ALL THRUST BLOCKS.

TITLE: **IRRIGATION - 3"Ø PVC PIPE THRUST BLOCK SCHEDULE**

DRAWN BY: STAFF	SCALE: NONE
REVIEWED BY: DANNY HILLSTOCK	REVISED: OCTOBER, 2019

APPROVED:

 CITY ENGINEER: DANNY HILLSTOCK LIC. NO. 70647 11-5-19 DATE

STANDARD PLAN
G-2
 SHEET 1 OF 1

CITY OF HOLLISTER
 ENGINEERING DEPARTMENT